


5.1 THRESHOLD, LAYOUT, WIRING DIAGRAM

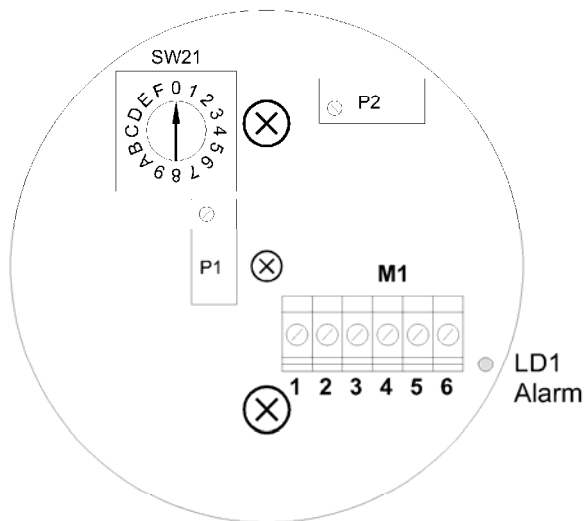

SW21 : Rotative switch to regulate the alarm threshold

- 0** Maximum threshold
- F** Minimum threshold

M1: External electrical connection

- 1** + Power supply (16 ÷ 24 VDC / 100 mA)
- 2** - Power supply
- 3** Not used
- 4** Relay contact (Common)
- 5** Relay contact (N.O.)
- 6** Relay contact (N.C.)




The trimmer P1 and P2 SHOULD NOT BE REGULATED

- 1** + Power supply (16 ÷ 24 VDC / 100 mA)
- 2** - Power supply
- 3** Not used
- 4** Relay contact (Common)
- 5** Relay contact (N.O.)
- 6** Relay contact (N.C.)



WARNING:
A wrong connection may irreparably damage the probe

EARTH : Earth connection

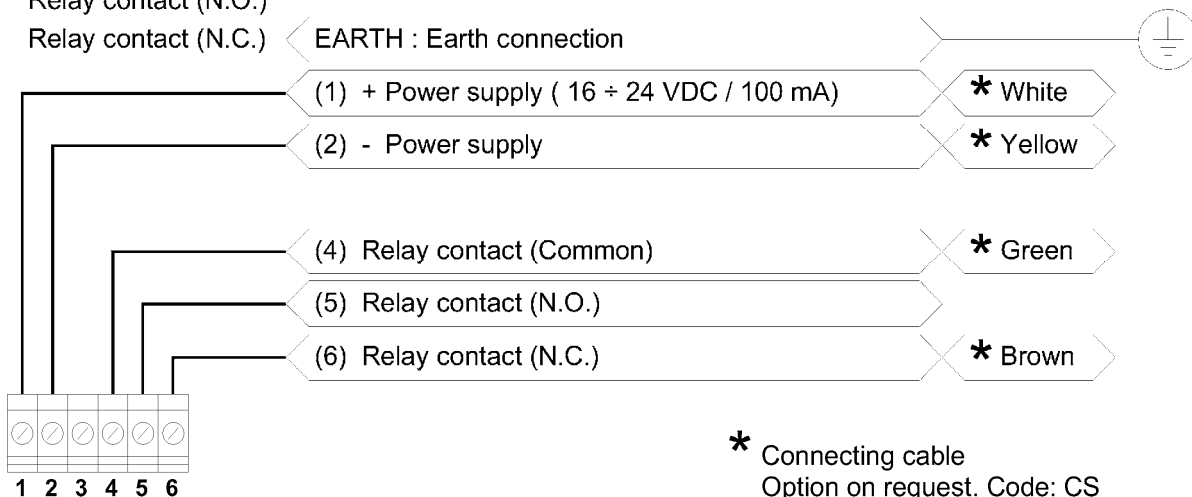

* Connecting cable
Option on request. Code: CS